Specific energy loss

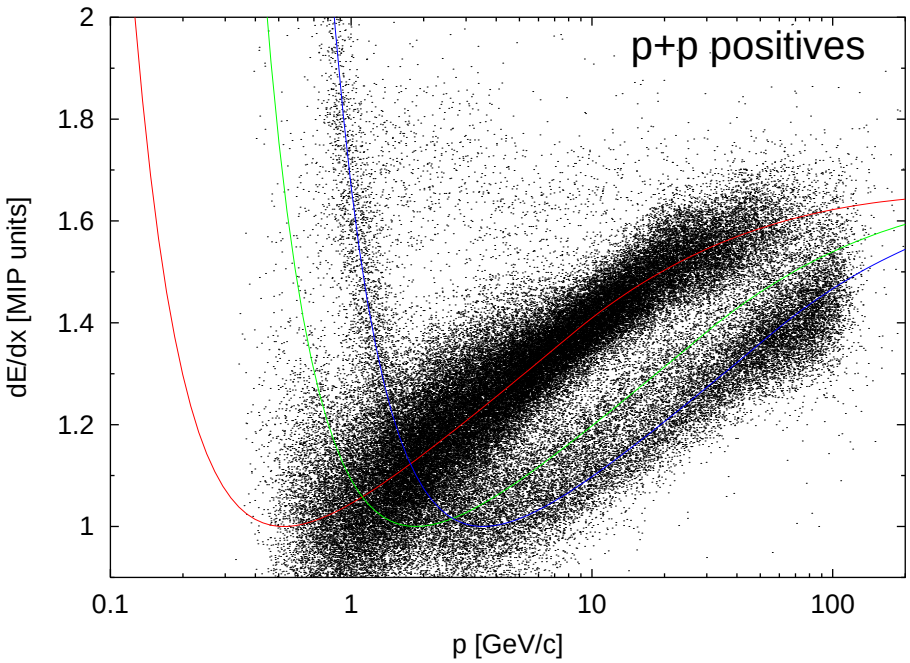

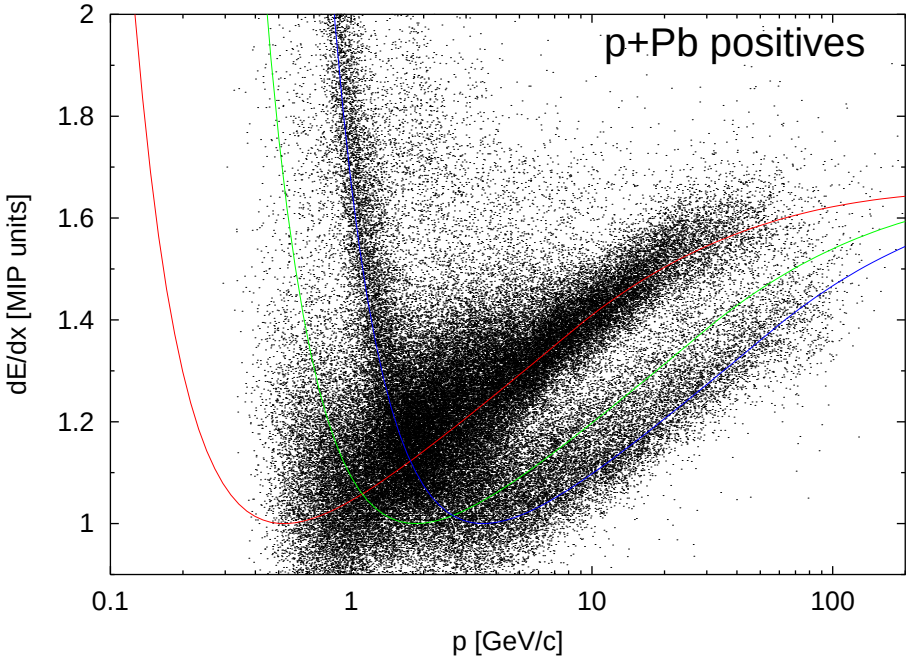

After calibration 3-4% relative resolution
with 6σ pion-proton separation